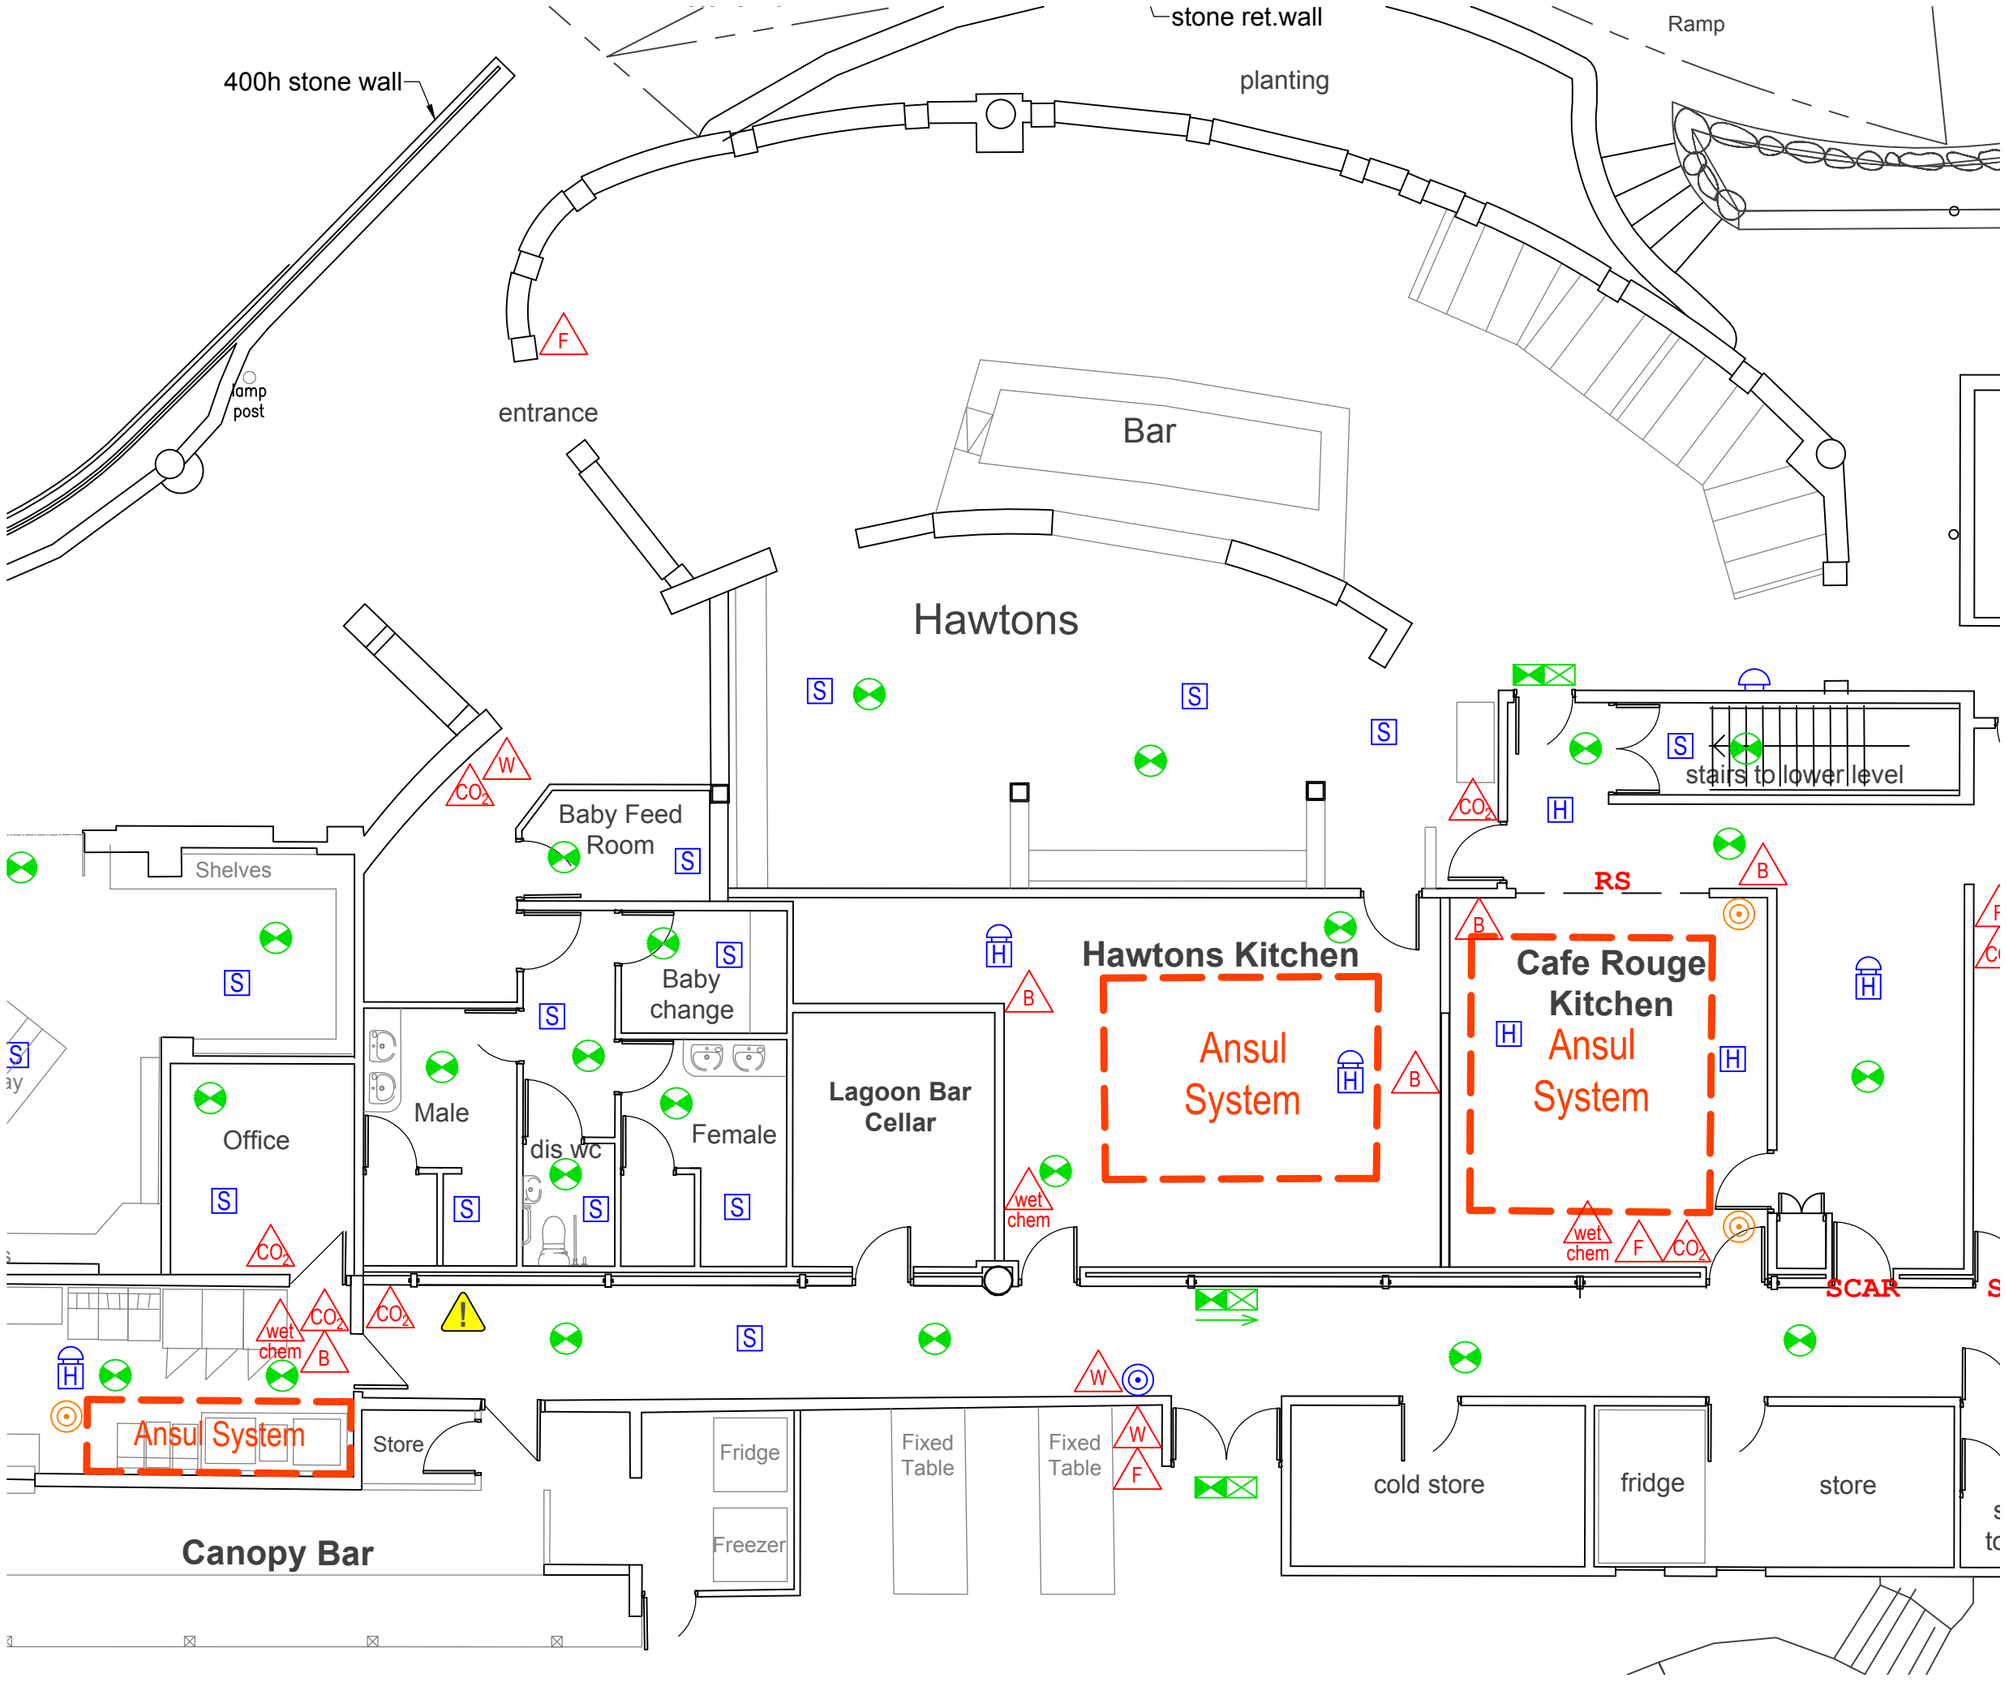

Fire Strategy Key :

- Fire alarm break glass operating point
- S — Fire alarm smoke detector
- H — Fire alarm heat detector
- Fire alarm sounder
- S/H — Fire alarm detector with sounder
- B — Fire alarm beam detector
- Fire alarm loud speaker
- W — Water type extinguisher
- F — Foam type extinguisher
- CO_2 — Carbon Dioxide type extinguisher
- DP — Powder type extinguisher
- B — Fire Blanket
- Emergency lighting luminaire
- Emergency lighting illuminated EXIT sign
- Emergency lighting box with spotlights
- E/E — Fire exit sign / Fire exit directional sign
- Gas shut off
- **FRG** — Fire Resistant Glazing
- **SCAR** — Self Closing Automatic Release
- **PB** — Push Bar door
- **RS** — Roller Shutter door
- Fire compartmentation 60mins
- **FR30** — Fire compartmentation 30mins
- Hazard

Rev.	Date	Remarks

Center Parcs Ltd
Head Office Development Department
One edison Rise, New Ollerton, Eakring, Newark, Notts. NG22 9DP
Tel: 01623 - 821835 Fax: 01623 - 821839

Project Title:
LONGLEAT FOREST
BUILDINGS

DrawingTitle:
(PLAZA LEVEL 1) HAWTONS
LICENCE PLAN

Dwg size:-	Dwg No:	Revision:
A3	03LF-02-07.52-1-03.1	

Scale:	Drawn:	Checked:	Date:
1:100@A3	MJT		15-Jun-16

S:\Development\006 - Drawings\03-Longleat\02 Buildings\07 Plaza\05 Units\052 Hawtons\01 Drawings\03LF-02-07.52-1-03 (Plaza Level 1) Hawtons LicencePlan.dwg